

**SPECIFICATIONS:**



1. ACID NEUTRALIZATION TANK T&C PLASTICS MODEL #\_\_\_\_\_ WITH MODEL RLS-50 LIMESTONE CHIPS.
2. SAMPLING TANK T&C PLASTICS MODEL NT-\_\_\_\_\_ WITH PH ELECTRODE.
3. PH MONITORING PANEL T&C PLASTICS PHCP-100 SERIES
4. POLYPROPYLENE SHUT OFF VALVE T&C PLASTICS MODEL PPV-\_\_\_\_\_
5. ACID WASTE VENT OUT
6. SANITARY HOUSE TRAP OR RUNNING TRAP WITH SANITARY VENT

**NOTES:**


- A. THE PLUMBING CONTRACTORS SHALL FURNISH AND INSTALL THE ACID NEUTRALIZATION TANK, LIMESTONE CHIPS, SAMPLING SUMP, PH MONITORING ALARM SYSTEM, AND MAKE ALL REQUIRED PIPING CONNECTIONS.
- B. THE ELECTRICAL CONTRACTOR TO PROVIDE ELECTRIC POWER TO CONTROL PANEL AND ANY NECESSARY CONDUIT FOR SENSORS OR ELECTRODE WIRES.
- C. STAND FOR SAMPLING TANK BY OTHERS.

**CONTROL PANEL OPTIONS:**


1. PHCP-100-SINGLE POINT PH MONITOR
2. PHCP-100-R-SINGLE POINT PH MONITOR IWTH DATALOGGER

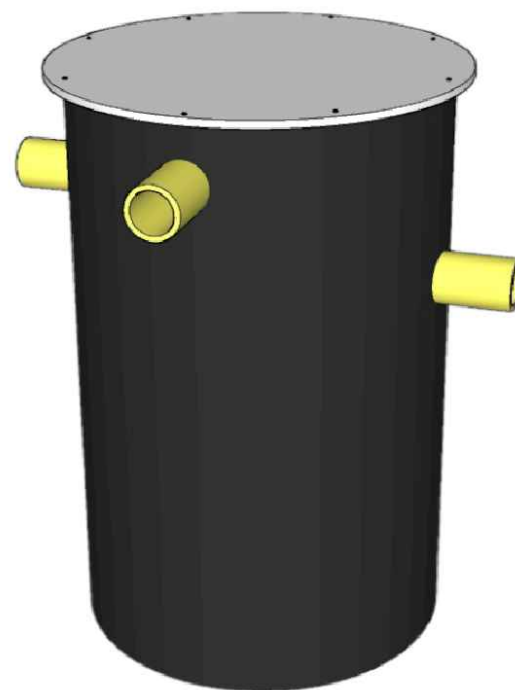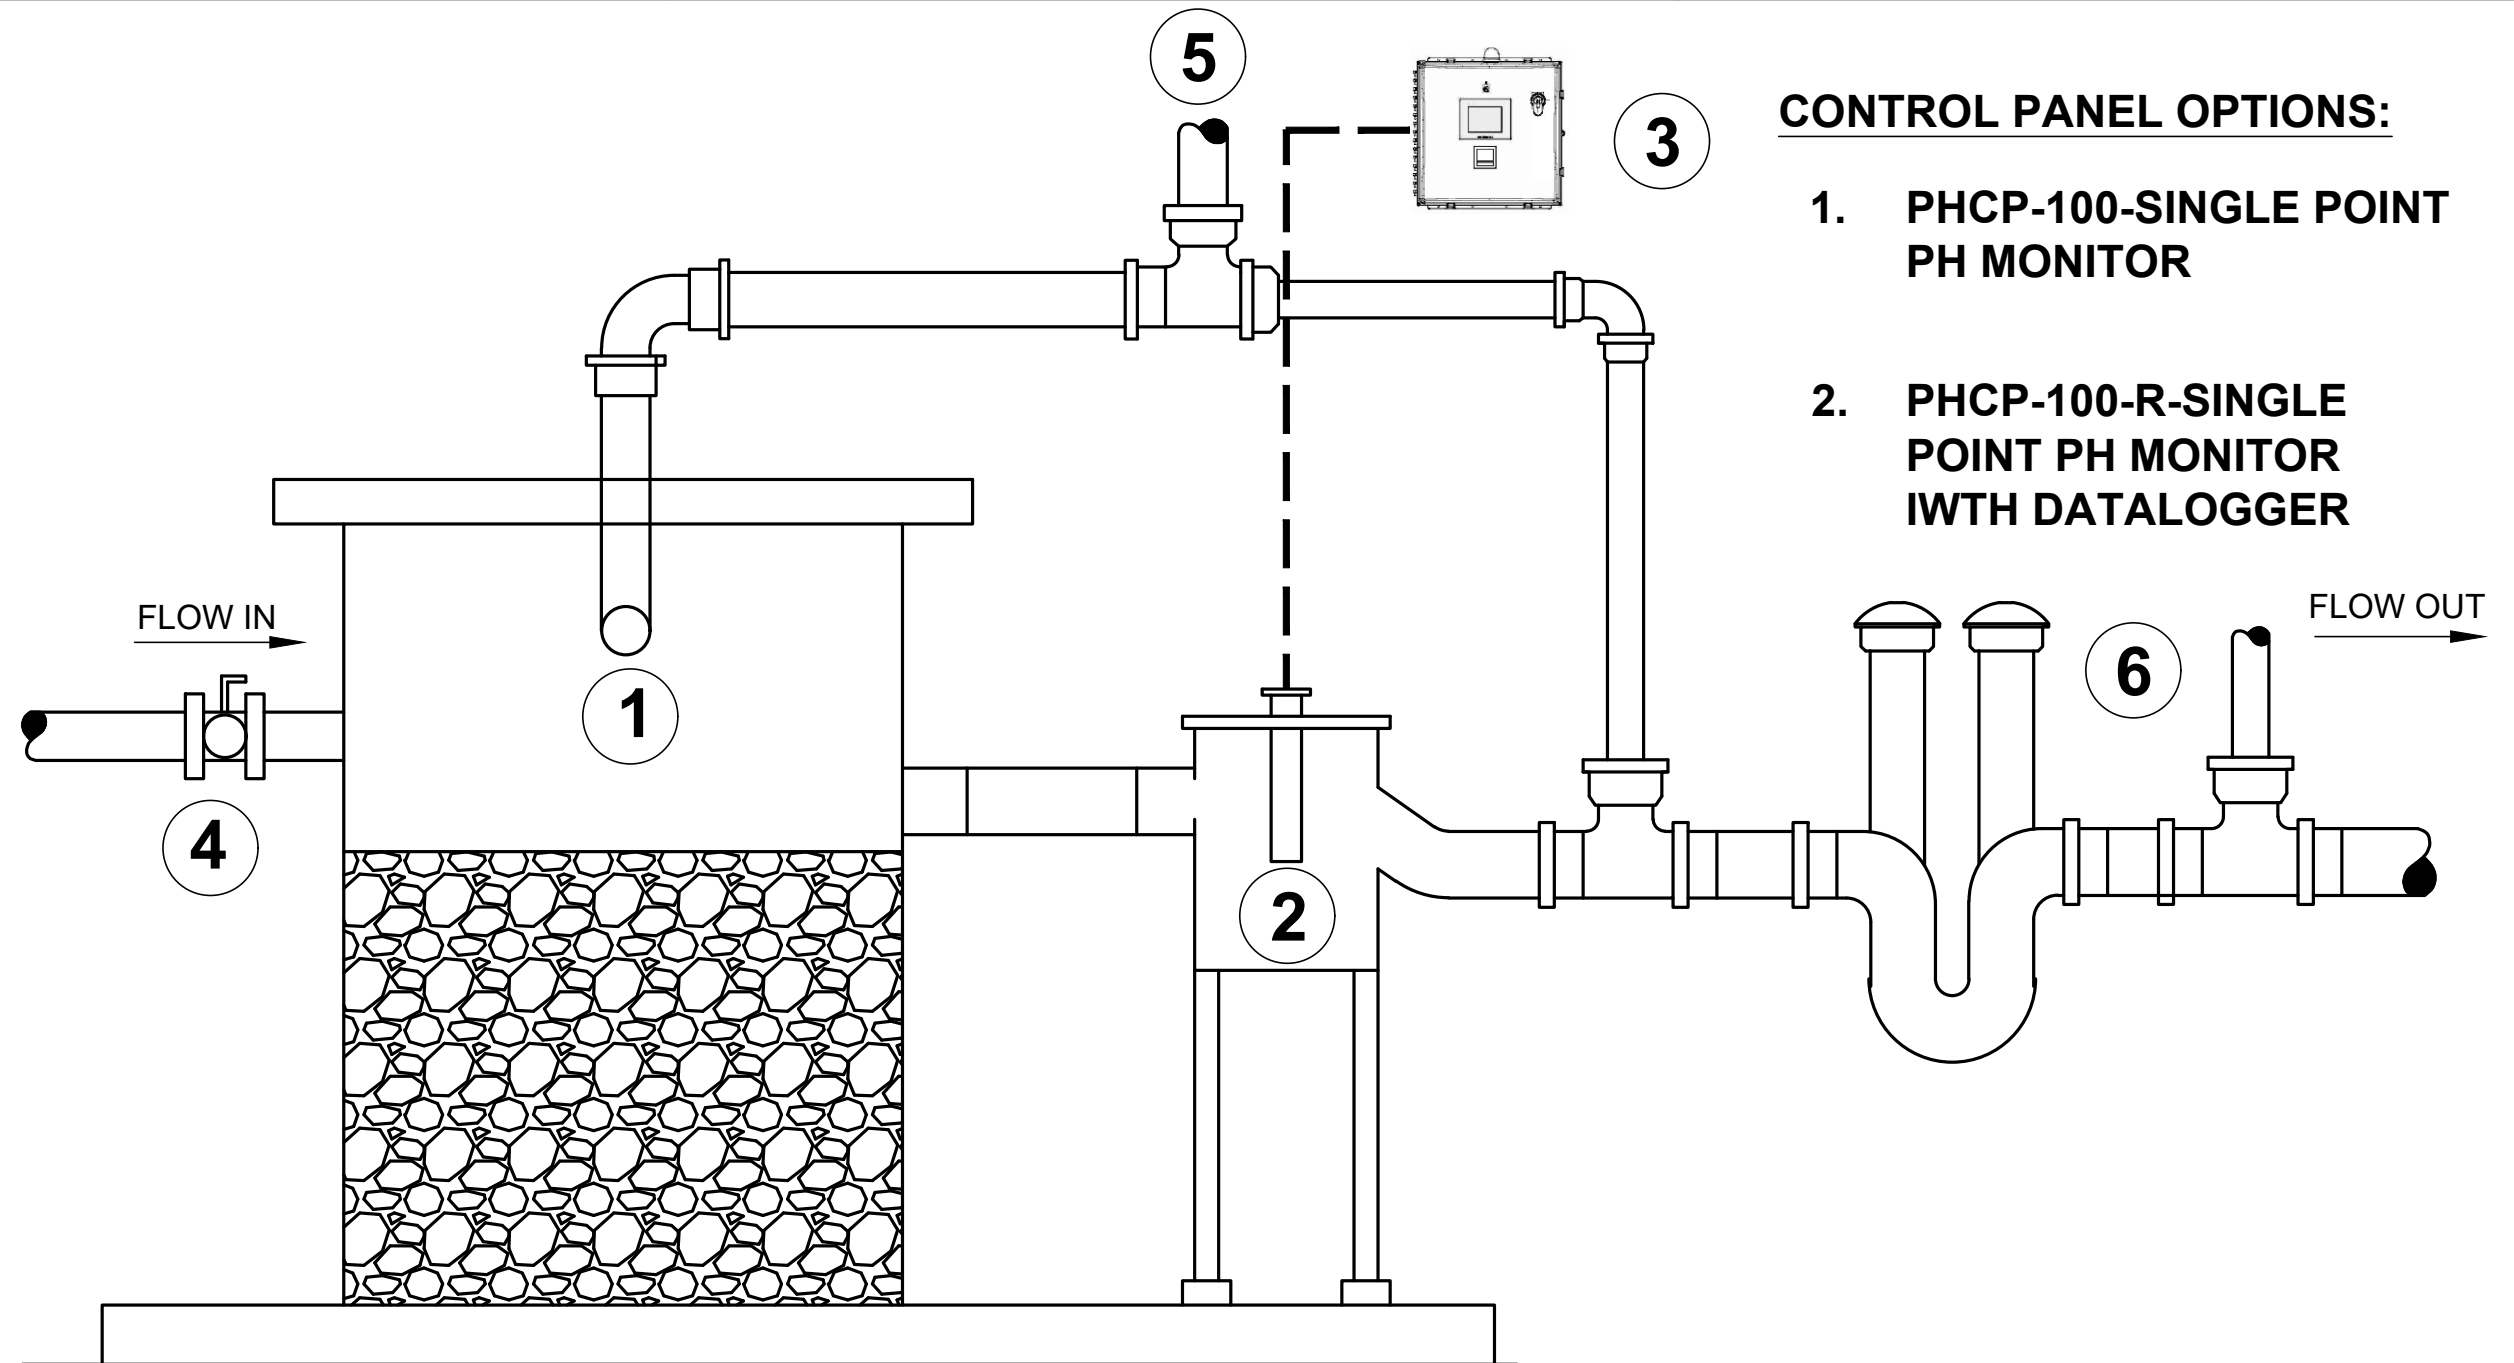


**NT TANK**

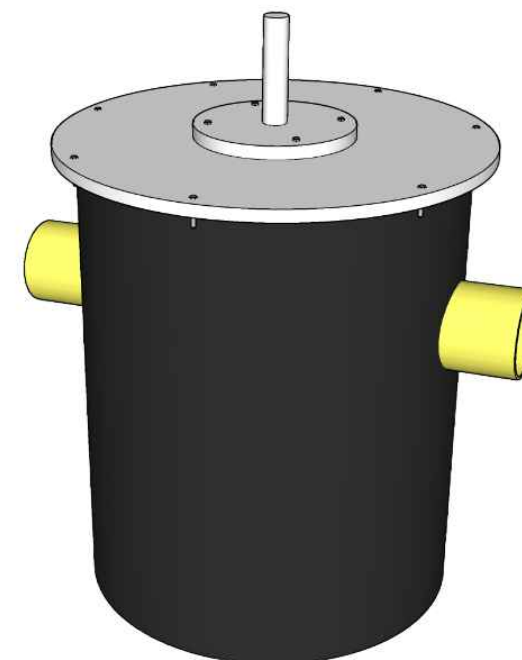

**NT-5M SAMPLING TANK**

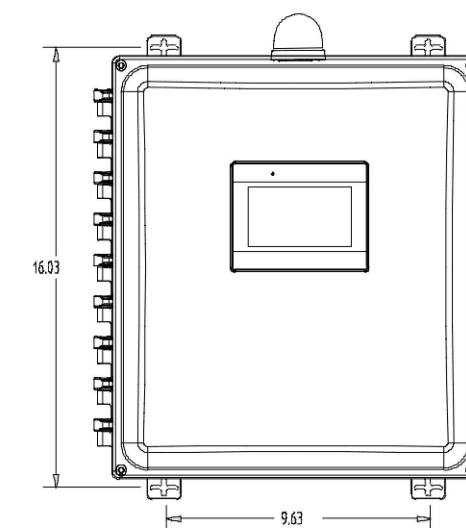

**PH MONITORING CONTROL PANEL**

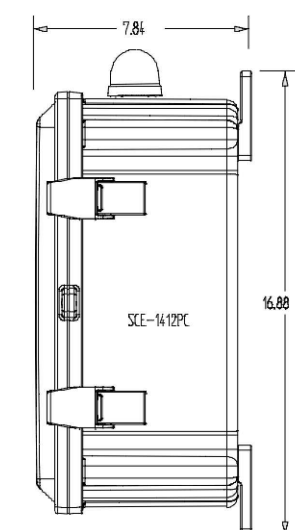

NOTES:

UNLESS STATED OTHERWISE DIMENSIONS ARE IN INCHES	MATERIAL: <b>HDPE / PP</b>			
	WEIGHT [lb]:	NAME		DATE
		DRAWN	DR	12/05/2022
	DO NOT SCALE DRAWING		CHECKED	

TITLE:

**METHOD 1B  
STANDARD  
INSTALLATION**

**NT SERIES**

SHEET 1 OF 1

SCALE: 1:2

REV:

SIZE:

**T&C  
PLASTICS**  
WWW.TANDCPLASTICS.COM  
732-780-5300

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF TOWN & COUNTRY PLASTICS LLC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF TOWN & PLASTICS LLC IS PROHIBITED.