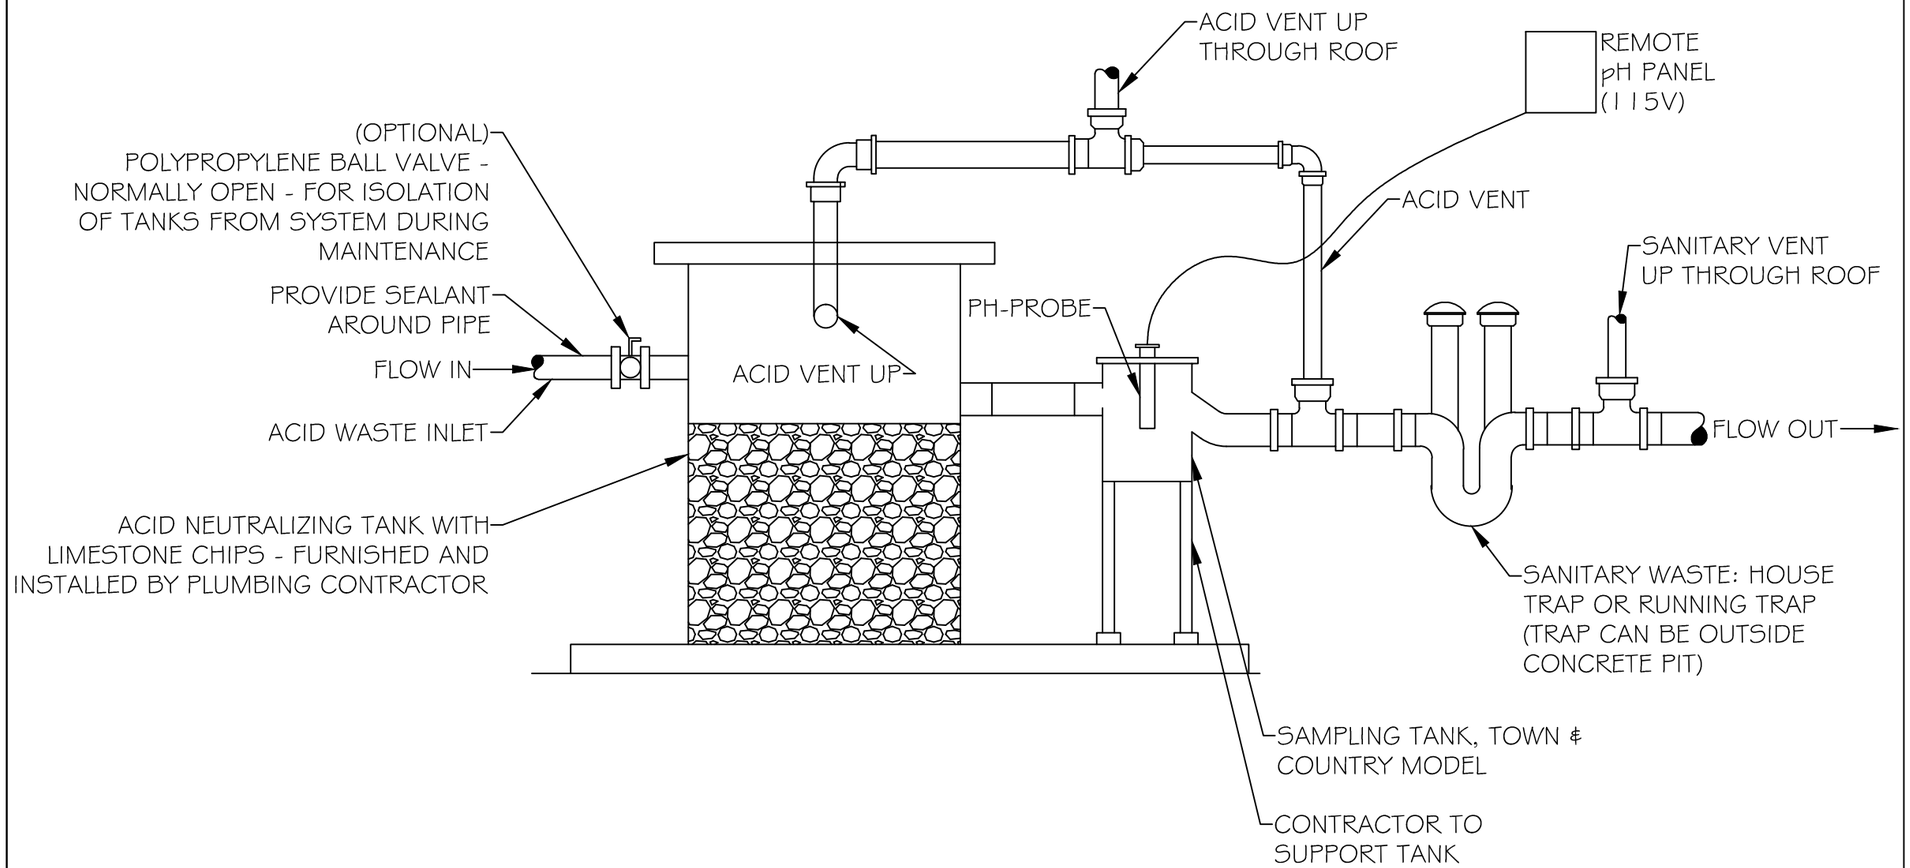

NOTES:

1.) THE PLUMBING CONTRACTOR SHALL FURNISH AND INSTALL THE ACID NEUTRALIZING TANK, SAMPLING SUMP, PH MONITORING ALARM SYSTEM AND MAKE ALL REQUIRED PIPING CONNECTIONS. FURNISH AND INSTALL PH CONTROL PANEL, WALL MOUNTED NEMA 4X OR 12, STEEL PANEL FINISHED WITH EPOXY PAINT, PRE-WIRED. (SEE SPECIFICATIONS)
2.) ELECTRICAL CONTRACTOR TO FURNISH AND INSTALL ALL WIRING CABLE FROM JUNCTION BOX PROBE ASSEMBLY TO CONTROL PANEL & CONDUIT. ALSO PROVIDE ELECTRIC POWER TO CONTROL PANEL. COORDINATE WITH ELECTRICAL CONTRACTOR. (SEE SPECIFICATION)

T&C TOWN & COUNTRY PLASTICS
Customized For Precision

Seal

TOWN & COUNTRY PLATICS, INC.
POST OFFICE BOX 269
MORGANVILLE, NJ 07751
PHONE: (732) 780-5300 - FAX: (732) 294-0001

Method 1B

DETAIL:
ACID NEUTRALIZING
TANK PIPING &
INSTALLATION

ABOVE GRADE INSTALL

Revisions:
ORIGINAL - 12.14.2016
REV 1 - 6.13.2017

Drawn:JJG
Revised:RC
Scale:NTS
Date:12-14-2016

DETAIL # 1